



FIRE ALARM SYSTEMS.
POWERED BY PARTNERSHIP.*

HIGH POWER CONTROL RELAY MODULE GSA-CRH

DESCRIPTION

The GSA-CRH High Power Control Relay Module is an addressable device designed for interface applications that require a high voltage, high current relay. Two identical sets of relay terminals are provided. Both sets of relay contacts transfer when the module is activated or restored. The state of the output terminals is not supervised.

The module requires one address on the signaling line circuit (SLC). The address is assigned electronically. There are no address switches to set.



STANDARD FEATURES

High Power Rating

120/240 VAC or 24 VDC rated contact can be used to control external appliances such as door closers, fans, dampers etc.

Provides one relay with two Form C contacts

Relay accepts 12 to 18 AWG (1.0 to 4.0 mm²) wiring from two sources.

Automatic device mapping

Signature modules transmit information to the loop controller regarding their circuit locations with respect to other Signature devices on the wire loop.

Removable terminal blocks

Easy wiring and module replacement.

Electronic addressing

Programmable addresses are downloaded from the loop controller or PC; there are no switches or dials to set.

Intelligent device

Distributed intelligence allows lower communication speed with substantially improved control panel response time and less sensitivity to line noise and loop wiring properties; twisted or shielded wire is not required.

*Kidde Commercial and its authorized resellers/distributors are separate and independent entities. This relationship between vendor and reseller/distributor does not constitute a legal partnership or create any shared liability between companies.

APPLICATION

Personality code

Use *Personality Code 8* to configure the GSA-CRH module:

Personality code 8: Signal - dry contact output. Configures the module as a dry relay contact to control external appliances (door closers, fan controllers, dampers) or equipment shutdown.

Indication

The status LED shows the state of the module through the cover plate:

- Normal: Green LED flashes
- Alarm/active: Red LED flashes

Compatibility

The GSA-CRH is part of the Signature Series intelligent processing and control platform. It is compatible with VM Series and VS Series control panels.

Warnings & Cautions

The GSA-CRH will not operate without electrical power. As fires frequently cause power interruption, we suggest you discuss further safeguards with your local fire protection specialist.

Kidde recommends that this module be installed according to latest recognized edition of national and local fire alarm codes.


Testing & Maintenance

GSA-CRH automatic self-diagnosis identifies when it is defective and causes a trouble message. The user-friendly maintenance program shows the current state of each module and other pertinent messages. Single modules may be turned off (deactivated) temporarily, from the control panel. Availability of maintenance features is dependent on the fire alarm system used. Scheduled maintenance (Regular or Selected) for proper system operation should be planned to meet the requirements of the Authority Having Jurisdiction (AHJ). Refer to current NFPA 72 and ULC CAN/ULC 536 standards.

Electronic Addressing


The loop controller electronically addresses the GSA-CRH, saving valuable time during system commissioning. Setting complicated switches or dials is not required. The module has its own unique serial number stored in its on-board memory.

INSTALLATION

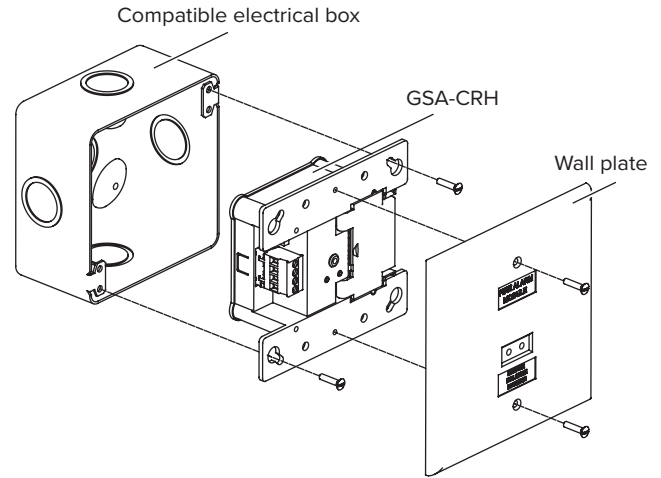

Consult the GSA-CRH High Power Control Relay Module Installation Sheet for details.

WIRING

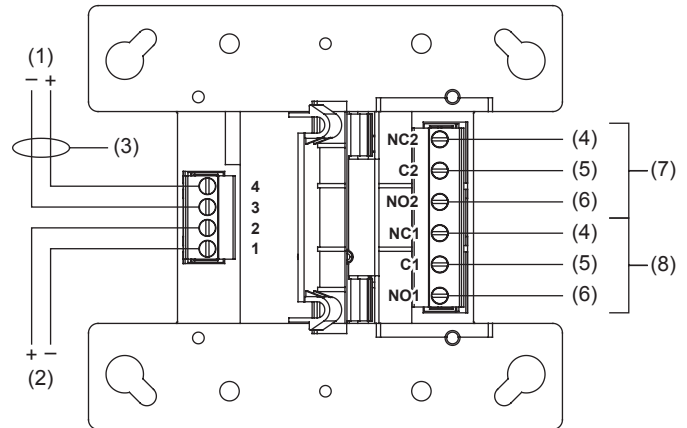

- (1) Signaling line circuit (SLC) from previous device
- (2) Signaling line circuit (SLC) to next device
- (3) Power-limited and supervised
- (4) Normally closed contact (NC)
- (5) Common contact (C)
- (6) Normally open contact (NO)
- (7) Relay terminal set 2.

Not supervised. Power-limited unless connected to a nonpowerlimited source. If the source is nonpower-limited, eliminate the power-limited mark and maintain a minimum of 0.25 in. (6.4 mm) space from power-limited wiring. For other mounting methods, see enclosure and bracket installation sheets to maintain separation of power-limited and nonpower-limited wiring. The wire size must be capable of handling fault current from a nonpower-limited source.

— or —

Use type FPL, FPLR, FPLP, or permitted substitute cables, provided these power-limited cable conductors extending beyond the jacket are separated by a minimum of 0.25 in. (6.4 mm) space or by a nonconductive sleeve or nonconductive barrier from all other conductors. Refer to the NFPA 70 National Electrical Code for more details.

- (8) Relay terminal set 1. Identical to (7).

SPECIFICATIONS

SLC operating voltage	15.20 to 19.95 VDC
SLC current	
Standby	75 μ A max.
Activated	75 μ A max.
Contact ratings [1][2]	
240 V 50/60 Hz	7 A (PF 0.75), 1.5 A (PF 0.35)
120 V 50/60 Hz	7 A (PF 0.75), 3.0 A (PF 0.35)
24 VDC	6 A resistive
Audio switching	0 to 20 kHz [3]
Relay type	2 Form C, programmable
Relay ready delay	
From power up	30 s max. (includes initial state set)
From previous activation	5 s max. (one activation)
	8 s max. (two activations, 1 s apart)
Circuit designation	
Signaling line circuits	Class A, Style 6 or Class B, Style 4. Refer to the control panel technical publications for SLC wiring details.
Relay circuits	Class E
Number of GSA-CRH per SLC	60 max.
Wire size	12 to 18 AWG (1.0 to 4.0 mm ²)
Compatible electrical boxes	North American double-gang $\times$ 2-1/8 in. (54 mm) deep box North American standard 4 in. square $\times$ 2-1/8 in. (54 mm) deep box
Agency Listings	CAN/ULC-S527, UL 864
Operating environment	
Temperature	32 to 120°F (0 to 49°C)
Relative humidity	0 to 93%, noncondensing
Storage temperature	-4 to 140°F (-20 to 60°C)

[1] Provide external fusing and back-EMF mitigation as required by your application. Do not use the GSA-CRH in a mixed application, where one set of relay terminals has high-power requirements and the other set carries a low-power signal, as this may result in physical contamination of the low-power signal contacts.

[2] The minimum load required in order to avoid long-term contact oxidation is 100 mA and 12 V.

[3] Power must not exceed the contact ratings shown for a given PF (power factor).

ORDERING INFORMATION

Catalog Number	Description	Ship Weight lbs (kg)
GSA-CRH	High Power Control Relay Module	0.4 (0.15)



FIRE ALARM SYSTEMS.
POWERED BY PARTNERSHIP.*

CONTACT US

Phone: 888.244.9979 (Option 4)
Email: kidde.fire@kgsolutions.com
Website: kidde-esfire.com

8985 Town Center Pkwy,
Bradenton, FL 34202

©2025 Walter Kidde Portable Equipment, LLC
All rights reserved.

*Kidde Commercial and its authorized resellers/
distributors are separate and independent entities.
This relationship between vendor and reseller/
distributor does not constitute a legal partnership
or create any shared liability between companies.